


City of Bellevue

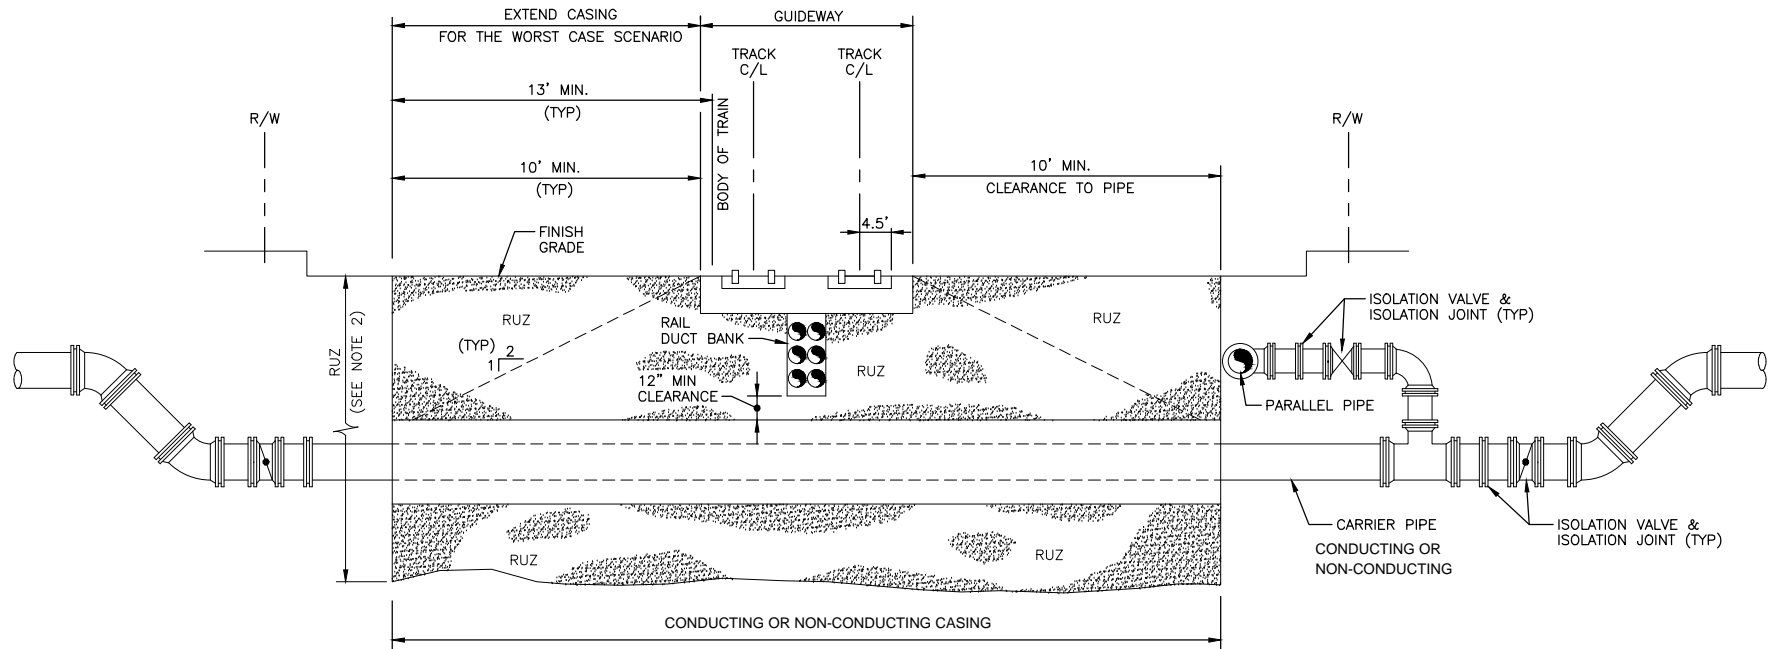

NOTES:

1. WATER PIPE CROSSING SHOWN, DETAIL FOR OTHER UTILITY CROSSINGS SIMILAR.
2. CONDUCTING CASING AND CARRIER PIPE SHALL BE CATHODICALLY PROTECTED REGARDLESS OF DEPTH. NON-CONDUCTING CARRIER PIPES AND CASINGS ARE NOT CATHODICALLY PROTECTED.
3. PARALLEL PIPE WITHIN 10-FT OF TRACK TO BE RELOCATED.
4. CATHODICALLY PROTECT RELOCATED / NEWLY INSTALLED CONDUCTING CARRIER PIPE AND CASING. NON-CONDUCTING CARRIER PIPES AND CASINGS ARE NOT CATHODICALLY PROTECTED.
5. VERTICAL AND HORIZONTAL THRUST RESTRAINT AND RESTRAINED JOINT PIPE ELEMENTS ARE REQUIRED BUT NOT SHOWN ON THIS DETAIL.

LEGEND

 RESTRICTED UTILITY ZONE (RUZ)

PIPE CROSSING DETAIL

N.T.S.