


NOTES:

1. THIS DRAWING INDICATES MINIMUM CONDUIT SIZES, WHERE SPECIFIED. CONDUIT DIAMETER ARE TO BE SIZED IN ACCORDANCE WITH CONDUIT FILL REQUIREMENTS.
2. THIS DRAWING INDICATES MINIMUM JUNCTION BOX SIZES, WHERE SPECIFIED. LARGER JUNCTION BOXES ARE REQUIRED WHERE JUNCTION BOX FILL CALCULATIONS DEEM NECESSARY.
3. THIS STD DWG PROVIDES DETAILS FOR CONDUITS ASSOCIATED WITH SMALL WIRELESS FACILITY POWER AND COMMUNICATIONS ONLY. ADDITIONAL TRAFFIC SIGNAL AND ILLUMINATION CONDUITS AND JUNCTION BOX DETAILS ARE NOT SHOWN.
4. SEE STD DWG SL-210-1 FOR SIGNAL AND SERVICE CABINET FOUNDATION DETAILS.
5. SEE STD DWG SL-120-1 FOR JUNCTION BOX AND CONDUIT DETAILS AT SWF LUMINAIRE LOCATIONS.
6. FINAL CONDUIT LAYOUT SHALL BE APPROVED BY REVIEW ENGINEER.
7. COMMUNICATION CONDUIT AND LARGE COMMUNICATION JUNCTION BOX ARE REQUIRED WHEN THERE IS AN EXECUTED AGREEMENT WITH DATA/TELECOMMUNICATION CARRIERS OPERATING UNDER A ROW AGREEMENT OR FRANCHISE OR WHEN A PROJECT REQUIRES FRONTAGE IMPROVEMENTS.



* SEE NOTE 7

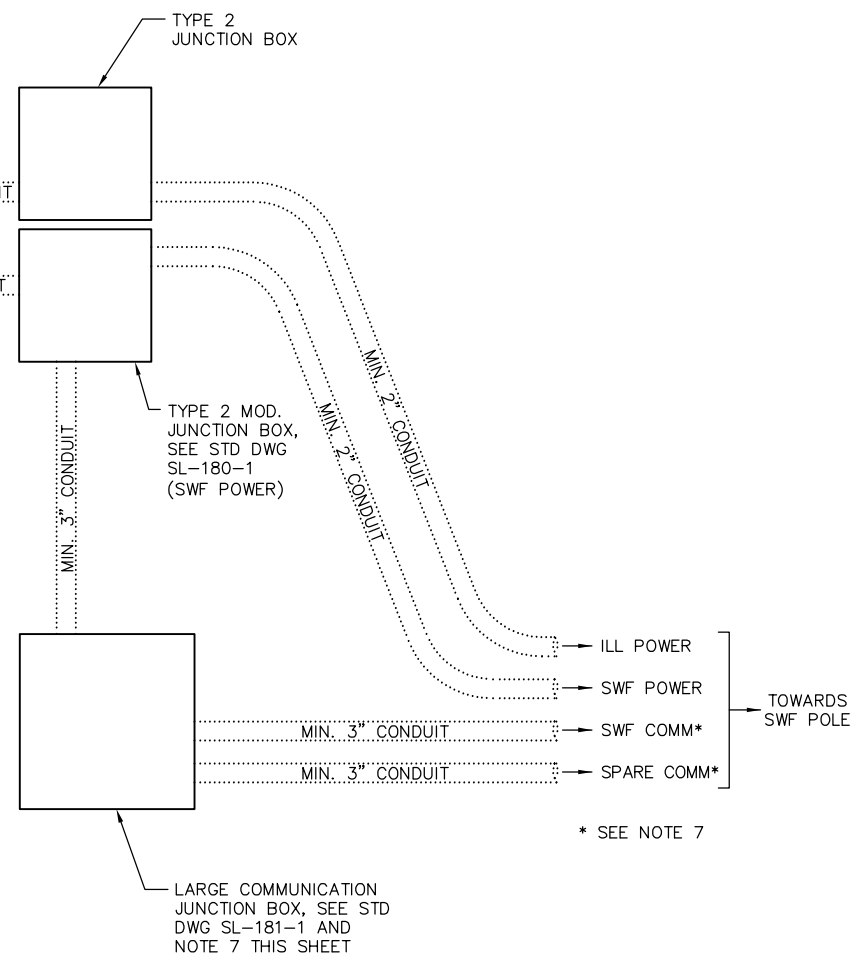

SMALL WIRELESS FACILITY COB-PROVIDED POWER CONDUIT AND JUNCTION BOX LAYOUT

DRAWING NUMBER	SL-121-1
SCALE	NONE
REVISION DATE	5/21
DEPARTMENT	TRANS