


**NOTES:**

1. CORE DRILL HOLE IN CATCH BASIN LID. GROUT WATER VALVE BOX IN PLACE.
2. ALL METAL PARTS & SURFACES MUST BE MADE OF CORROSION RESISTANT MATERIAL OR GALVANIZED. COMPLETE CORROSION PROTECTION MUST BE ASSURED.

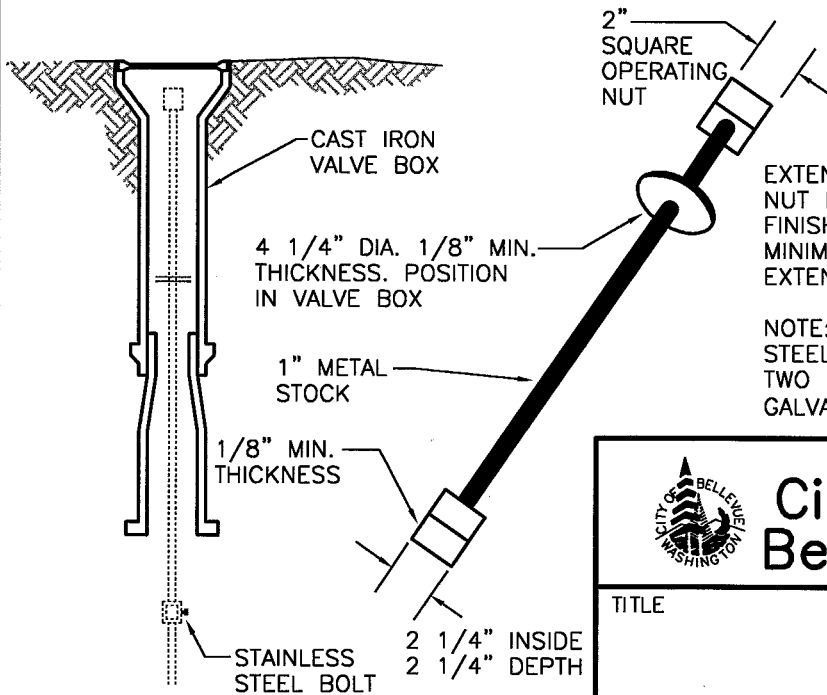

EXTENSIONS ARE REQUIRED WHEN THE OPERATING NUT IS MORE THAN THREE(3) FEET BELOW FINISHED GRADE. EXTENSIONS ARE TO BE A MINIMUM OF ONE(1) FOOT LONG, ONLY ONE EXTENSION TO BE USED PER SHEAR GATE.

NOTE: ALL EXTENSIONS ARE TO BE MADE OF STEEL, SIZED AS NOTED, AND PAINTED WITH TWO COATS OF METAL PAINT OR HOT DIPPED GALVANIZED.



**City of Bellevue**

SURFACE WATER UTILITY

TITLE

SHEAR GATE VALVE EXTENSION